


INTERNAL VIEW  
SHOWING "V" BANK  
PANEL ARRANGEMENT

HOUSING FRAME

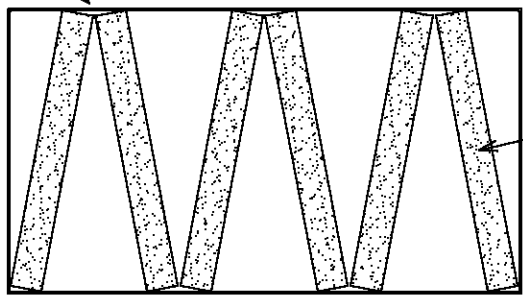


SIX (6) FILTER PANELS,  
NOMINAL 2" DEPTH,  
26 GAUGE FRAME WITH  
26 GA. PERF. SCREENS (.045"  
HOLES, 37% OPEN AREA)

FLOW

NOTE 4

FLOW

NOTE 5

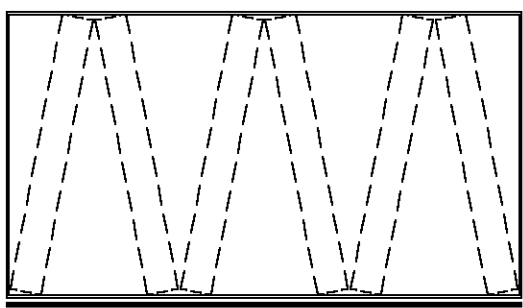


SIDE VIEW

DEPTH  
16 OR 18

24 WIDTH

3/4 FLANGE (typ.)

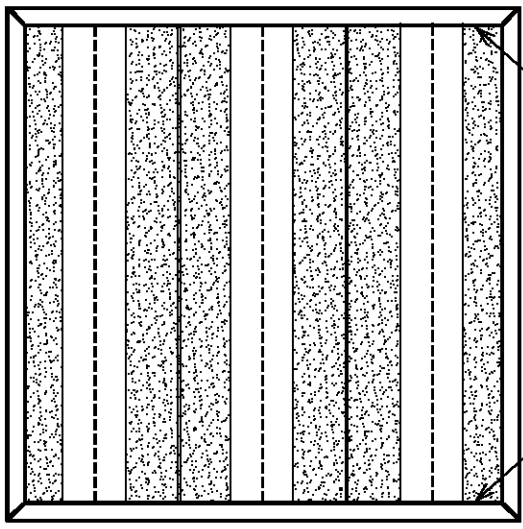

RIGHT END VIEW  
FACING AIR OUTLET

NOTES

1. MATERIAL: 304 SS, 16 GA. FRAME, 20 GA. END CAPS
2. RATED FLOW: 1000 CFM AT 250 FPM FACE VELOCITY
3. PRESSURE DROP AT RATED FLOW: 1.3" W.G.
4. JOINTS BETWEEN TRAYS ARE GASKETED, CAULKED,  
AND COVERED WITH END CAPS TO PREVENT BYPASS.
5. GASKET ON UPSTREAM FACE OF FILTER:  
3/4" X 1/4" CLOSED CELL EDPM MATERIAL
6. TRAY ENDS ARE POTTED (SEALED) TO HOUSING  
FRAME TO PREVENT BYPASS.
7. SUITABLE FOR USE IN "BAG IN-BAG OUT" APPLICATIONS.

APPROXIMATE WEIGHTS (LBS).	16" DEPTH	18" DEPTH
EMPTY HOUSING	76	90
STANDARD CARBON @ 30 LB./FT3:	70	80
IMPREGNATED GAC @ 34 LB./FT3:	80	90

PROPRIETARY DRAWING  
DRAWING MAY NOT BE USED OR REPRODUCED  
WITHOUT WRITTEN AUTHORIZATION OF  
CAMERON GREAT LAKES, INC.

**CAMERON GREAT LAKES, INC.**  
2335 NW 29th AVE. PORTLAND, OR 97210  
TEL. 800-777-4044 FAX 503-225-0137

DRAWN:	JMB	TITLE:	GENERAL ARRANGEMENT
CHECKED:	PJL	ZBH-SS-16 & ZBH-SS-18	304SS
APPROVED:	RAH	ZERO BYPASS FILTER HOUSING	
REV.	DATE	BY	REMARKS
-	02/01/00	JMB	ORIGINAL ISSUE
TOLERANCES: LENGTH +/- 0.125 IN.		SCALE:	N.T.S.
		DWG. NO.	ZBH-SS-16/18